



PLAN VIEW
NTS

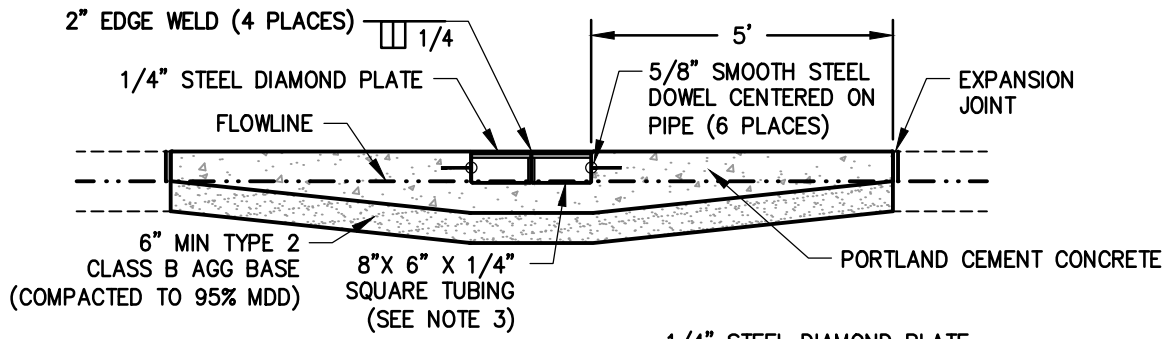

SECTION A-A
NTS

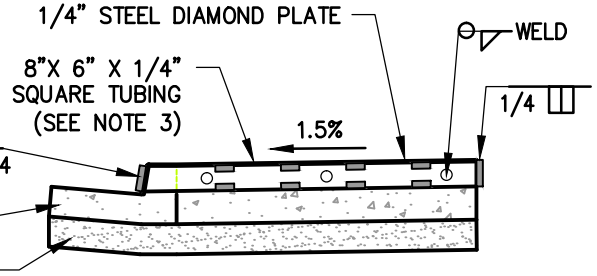

SECTION B-B
NTS

NOTES:

1. SHARP EDGES SHALL BE GROUND OFF.
2. FIBER-REINFORCED PORTLAND CEMENT CONCRETE (P.C.C.) SHALL HAVE THE FOLLOWING CHARACTERISTICS: 4000 PSI MIN. COMPRESSIVE STRENGTH @ 28 DAYS, MIN. 6 SACKS OF CEMENT PER CUBIC YARD WITH A MAX. WATER/CEMENT RATIO OF 0.45, AIR ENTRAINMENT 6% ±1.5%, SLUMP AT 1 TO 4 INCHES. ALL MATERIALS SHALL CONFORM TO SSPWC SECTION 202. POLYPROPYLENE FIBERS SHALL BE ADDED TO THE P.C.C. PER THE MANUFACTURER'S RECOMMENDATIONS.
3. ROLLED CURB SHALL USE 7" X 5" X 1/4" TUBE. CONSTRUCT 5' TRANSITIONS FROM ROLLED CURB TO TYPE 1 CURB AT INLET. MAINTAIN ROLLED CURB FLOWLINE PROFILE THROUGHOUT TRANSITION.

NO.	REVISION	DATE	STANDARD DETAIL FOR PUBLIC WORKS CONSTRUCTION	SECTION
1	REDESIGN	9/17	SIDEWALK CROSS-DRAIN	CARSON CITY
				DRAWING NO. C-4.1.8
				DATE SEP 2017
APPROVED BY:		9/17		